DIMENSIONS AND CONNECTIONS OF TYPE M, FORM D3 LIGHTNING ARRESTERS

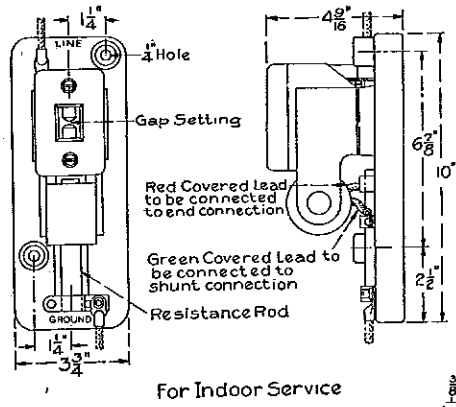

For Indoor Service

Cat. No.	Voltage	Gap Setting	Res. Rod Cat. No.
164403	0-350	.025	33868
164405	350-750	.025	33869

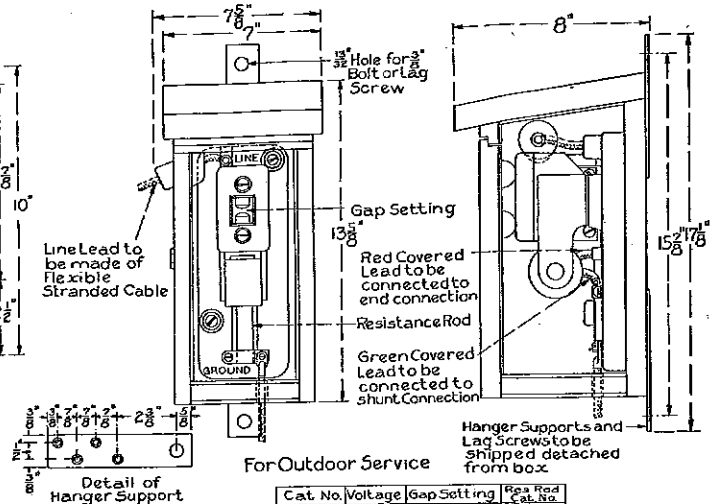

For Outdoor Service

Cat. No.	Voltage	Gap Setting	Res. Rod Cat. No.
164404	0-350	.025	33868
164406	350-750	.025	33869

Up to 750 Volts

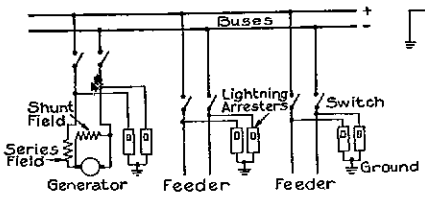

Connections for D.C. Ungrounded Circuit up to 750 Volts

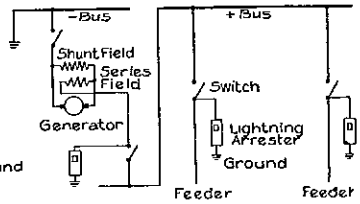

Connections for D.C. Grounded Return Circuit up to 750 Volts Machine Equalizing on Positive Side Equalizers are not shown

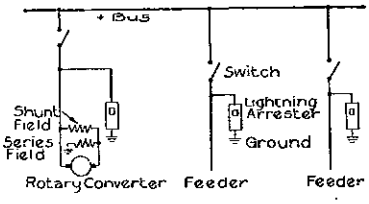

Connections for D.C. Grounded Return Circuit up to 750 Volts Machine Equalizing on Negative Side Equalizers are not shown

For REFERENCE ONLY unless endorsed on back.

3 MAY, 1915

No. 14877

Supersedes WP 14120, DS 581414 and 581415

ENGINEERING DEPT.
GENERAL ELECTRIC COMPANY