


428687

DB-986A LINE BREAKER, COVER REMOVED.

INDEX E-35F

4 7 25

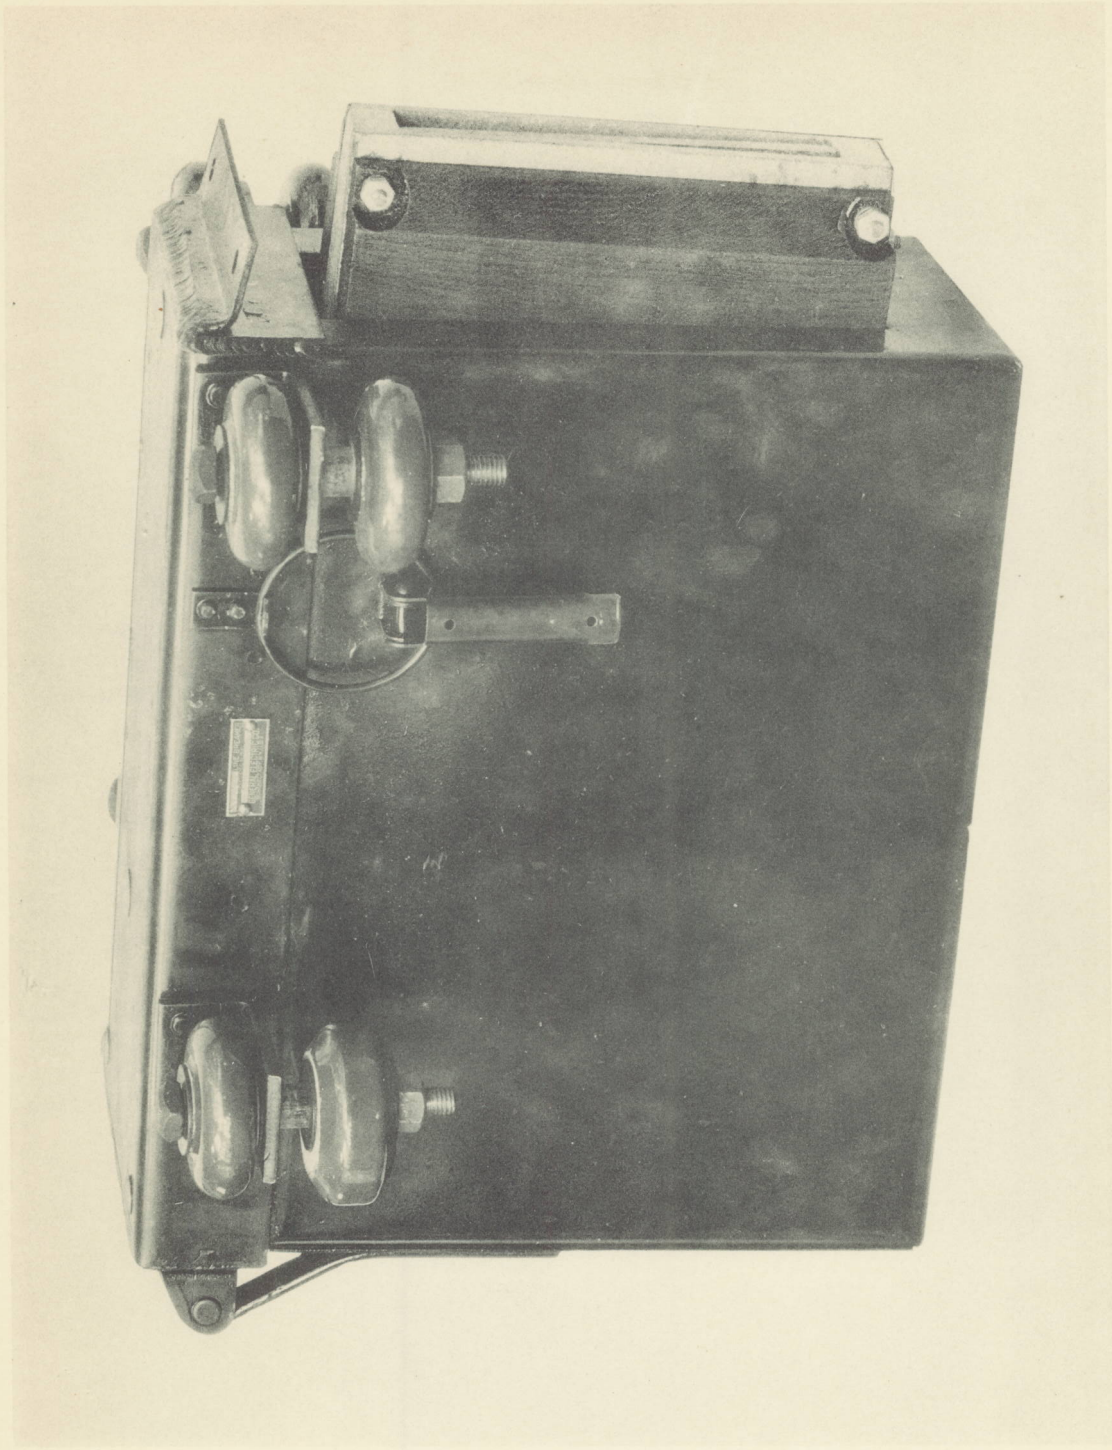


428686

DB-986A LINE BREAKER.
INDEX E-356.1

4 7 25


DIMENSIONS AND CONNECTIONS OF G-E LINE BREAKERS

Types DB-986A and DB-994A

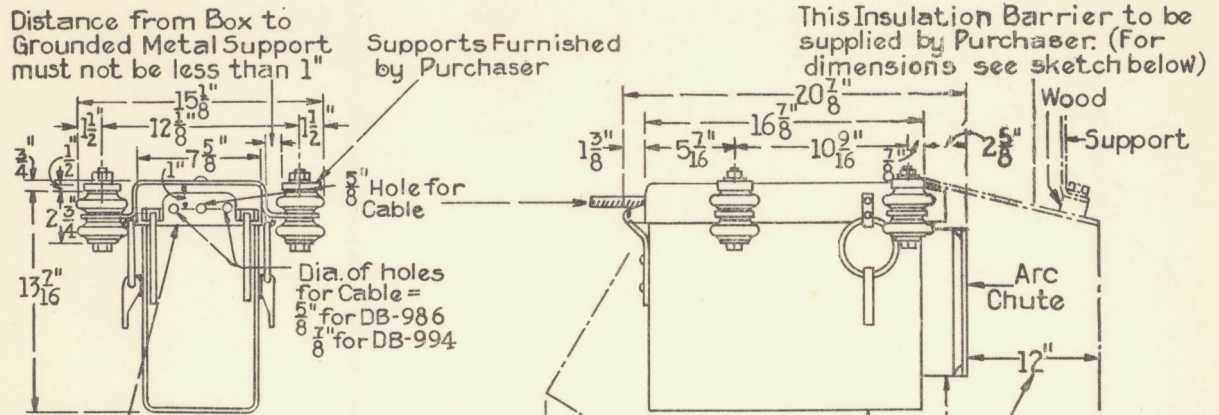

Lower half of Wood Cable Clamp to be removed when wiring so that Cables can be installed with minimum amount of slack.

Distance from Box to Grounded Metal Support must not be less than 1"

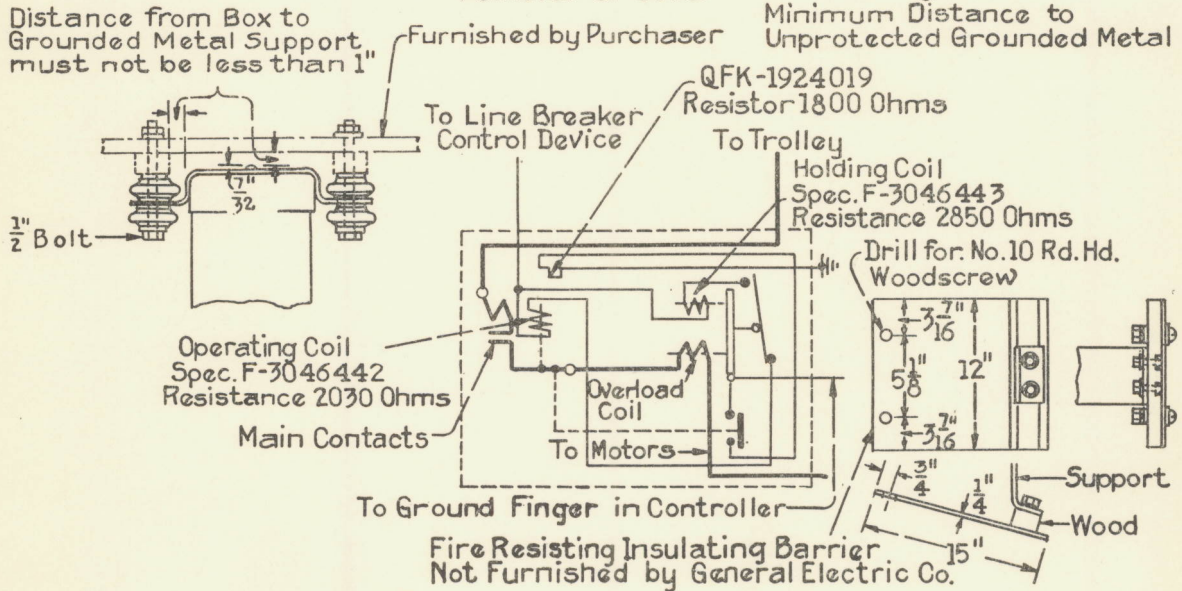

For REFERENCE ONLY unless endorsed.

DISTRICT OFFICES MAY APPROVE THIS PRINT FOR CONSTRUCTION.

MAY 1, 1929

GEM-518

ENGINEERING DEPT.
GENERAL ELECTRIC COMPANY, U.S.A.

2m 5-15-29

